

# TABLE OF CONTENTS

## REQ-B7

1	Features .....	1
2	Specifications .....	2
	Technical Specifications .....	2
	Electrical Specifications .....	4
	Electrical data .....	5
	Safety device settings .....	8
3	Options .....	9
4	Dimensional drawing & centre of gravity .....	10
	Dimensional drawing .....	10
	Centre of gravity .....	11
5	Piping diagram .....	13
6	Wiring diagram .....	14
	Wiring diagram .....	14
	External connection diagram .....	15
7	Sound data .....	16
	Sound pressure spectrum .....	16
	Sound power spectrum .....	16
8	Installation .....	19
	Installation method .....	19
9	Operation range .....	21

# 1 Features

1  
1

- Outdoor units for pair and twin application
- Daikin outdoor units are neat and sturdy and can be mounted easily on a roof or terrace or simply placed against an outside wall.
- Outdoor units are fitted with a scroll compressor, renowned for low noise and high energy efficiency.
- The piping connections can be accessed from underneath, front, side or rear.
- The service valves are hidden inside the casing.
- A special acryl pre-coated fin for anti-corrosion treatment on the heat exchanger ensures greater resistance against severe weather conditions



## 2 Specifications

2-1 TECHNICAL SPECIFICATIONS				REQ71B7V3B	REQ71B7W1B	REQ100B7V3B	REQ100B7W1B	REQ125B7W1B	
Casing	Colour			Daikin White					
	Material			Painted galvanized steel plate					
Dimensions	Packing	Height	mm	900	900	1300	1300	1300	
		Width	mm	980	980	980	980	980	
		Depth	mm	420	420	420	420	420	
	Unit	Height	mm	770	770	1170	1170	1170	
		Width	mm	900	900	900	900	900	
		Depth	mm	320	320	320	320	320	
Weight	Machine Weight		kg	83	83	102	100	108	
	Gross Weight		kg	87	87	107	105	113	
Heat Exchanger	Dimensions	Length	mm	857	857	857	857	857	
		Nr of Rows			2	2	2	2	2
		Fin Pitch	mm	2.00	2.00	2.00	2.00	2.00	
		Nr of Passes			6	6	10	10	10
		Face Area	m <sup>2</sup>	0.641	0.641	0.980	0.980	0.980	
		Nr of Stages			34	34	52	52	52
	Tube type			Hi-XSS cooling tube					
	Fin	Type	Non-symmetric waffle louvre						
Treatment		Anti-corrosion treatment (PE)							
Fan	Type			Direct Drive Propeller					
	Discharge direction			Horizontal					
	Quantity			1	1	1	1	2	
	Air Flow Rate (nominal)	Cooling	m <sup>3</sup> /min	48.0	48.0	55.0	55.0	89.0	
		Heating	m <sup>3</sup> /min	43.0	43.0	50.0	50.0	80.0	
	Motor	Quantity		1	1	1	1	1	
		Model		P47L11S					
Position						Lower			
Motor	Speed (nominal at 230V)	Steps	3	3	3	3	3		
Fan	Motor	Output	W	65	65	90	90	85	
		Drive			direct drive				
	Position						Upper		
Motor	Speed (nominal at 230V)	Steps					3		
Fan	Motor	Output	W					65	
		Drive			direct drive				
Compressor	Quantity			1	1	1	1	1	
	Motor	Model		JT90G-V1N	JT90G-YE	JT125G-V1N	JT125G-YE	JT160G-YE	
		Type			Hermetically sealed scroll compressor				
		Motor Output	W	2200	2200	3000	3000	3750	
		Starting Method			Direct				
	Crankcase Heater	W	33	33	33	33	33		
Operation Range	Cooling	Min	°CDB	10.0	10.0	10.0	10.0	10.0	
		Max	°CDB	46.0	46.0	46.0	46.0	46.0	
	Heating	Min	°CWB	-10.0	-10.0	-10.0	-10.0	-10.0	
		Max	°CWB	15.0	15.0	15.0	15.0	15.0	
Sound Level (nominal)	Cooling	Sound Power	dBA	65.0	65.0	70.0	70.0	70.0	
		Sound Pressure	dBA	53.0	53.0	57.0	57.0	57.0	

1  
2

2-1 TECHNICAL SPECIFICATIONS			REQ71B7V3B	REQ71B7W1B	REQ100B7V3B	REQ100B7W1B	REQ125B7W1B	
Refrigerant	Type		R-410A					
	Charge	kg	2.50	2.50	3.60	3.60	3.60	
	Control		Expansion valve (electronic type)					
	Nr of Circuits		1	1	1	1	1	
Refrigerant Oil	Type		Daphne FVC68D					
	Charged Volume	l	1.5	1.5	1.5	1.5	1.5	
Piping connections	Liquid (OD)	Quantity		1	1	1	1	1
		Type		Flare connection				
		Diameter (OD)	mm	9.52	9.52	9.52	9.52	9.52
	Gas	Quantity		1	1	1	1	1
		Type		Flare connection				
		Diameter (OD)	mm	15.9	15.9	15.9	15.9	15.9
	Drain	Quantity		3	3	3	3	3
		Type		Hole				
	Piping Length	Minimum	m	5	5	5	5	5
		Maximum	m	50	50	50	50	50
		Equivalent	m	70	70	70	70	70
		Chargeless	m	7.5	7.5	7.5	7.5	7.5
	Installation height difference	Maximum	m	30.0	30.0	30.0	30.0	30.0
		Max. interunit level difference	m	0.5	0.5	0.5	0.5	0.5
	Heat Insulation		Both liquid and gas pipes					
Defrost Method		Reversed cycle						
Defrost Control		Sensor for outdoor heat exchanger temperature						
Capacity Control Method		None						
Safety Devices		Reverse phase protector						
		PC board fuse						
		Overcurrent relay (compressor)						
		Low pressure switch						
		High pressure switch						
		Fan motor thermal protector						
Standard Accessories	Item		Declaration of conformity					
	Quantity		1	1	1	1	1	
	Item		Installation manual					
	Quantity		1	1	1	1	1	
Notes		Sound pressure level is a relative value, depending on the distance and acoustic environment. For more details, please refer to sound level drawings of this chapter.						
		The sound power level is an absolute value indicating the power which a sound source generates.						
		Sound values are measured in a semi-anechoic room.						
		In case of drain piping for outdoor unit, drain piping kit (option) is needed.						
		Nominal cooling capacities are based on : indoor temperature : 27°CDB, 19°CWB, outdoor temperature : 35°CDB, equivalent refrigerant piping : 7.5m, level difference : 0m.						
Nominal heating capacities are based on : indoor temperature : 20°CDB, outdoor temperature : 7°CDB, 6°CWB, equivalent refrigerant piping : 7.5m, level difference : 0m								

2-2 ELECTRICAL SPECIFICATIONS			REQ71B7V3B	REQ71B7W1B	REQ100B7V3B	REQ100B7W1B	REQ125B7W1B
Power Supply	Name		V3	W1	V3	W1	W1
	Phase		1	3N	1	3N	3N
	Frequency	Hz	50	50	50	50	50
	Voltage	V	230	400	230	400	400
Current	Z-max	Text	0,06+j0,04	0,35+j0,22	0,04+j0,02	0,31+j0,19	0,26+j0,16
	Recommended fuses	A	32	16	40	16	20
Voltage range	Minimum	V	207	360	207	360	360
	Maximum	V	253	440	253	440	440
Wiring connections	For Power Supply	Quantity	1	1	1	1	1
		Remark	3 wires (earth wire included)	5 wires (earth wire included)	3 wires (earth wire included)	5 wires (earth wire included)	5 wires (earth wire included)
	For connection with indoor	Quantity	1	1	1	1	1
		Remark	4 wires (earth wire included)				
Power Supply Intake			Outdoor unit only				

NOTES

1  
2

## 2 - 3 Electrical data

### REQ71B7

Unit combination		Power supply				Compressor		OFM		IFM		
Indoor unit	Outdoor unit	Hz-Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FCQ71	REQ71B7V3B	50-230	Max. 50Hz-253V Min. 50Hz-207V	16.6	23.3	32	75.5	12.2	0.065	0.6	0.045	0.7
FHQ71	REQ71B7V3B	50-230		16.8	23.2	32	75.5	12.5	0.065	0.6	0.062	0.6
FBQ71	REQ71B7V3B	50-230		17.4	23.5	32	75.5	12.7	0.065	0.6	0.125	0.9
FDEQ71	REQ71B7V3B	50-230		15.4	23.5	32	75.5	11.1	0.065	0.6	0.125	0.9
FCQ71	REQ71B7W1B	50-400/230	Max. 50Hz-440/253V Min. 50Hz-360/207V	7.3	11.3	16	41.1	4.8	0.065	0.6	0.045	0.7
FHQ71	REQ71B7W1B	50-400/230		7.5	11.2	16	41.1	5.0	0.065	0.6	0.062	0.6
FBQ71	REQ71B7W1B	50-400/230		8.1	11.5	16	41.1	5.3	0.065	0.6	0.125	0.9
FDEQ71	REQ71B7W1B	50-400/230		6.8	11.5	16	41.1	4.2	0.065	0.6	0.125	0.9

3TW26599-9

#### SYMBOLS

MCA : Min. Circuit Amps  
 TOCA : Total Over Current Amps  
 MFA : Max. Fuse Amps (see note 7)  
 LRA : Locked Rotor Amps  
 RLA : Rated Load Amps  
 OFM : Outdoor Fan Motor  
 IFM : Indoor Fan Motor  
 FLA : Full Load Amps  
 kW : Rated motor output

#### NOTES

1. RLA is based on the following conditions:  
 Indoor temp.: 27°CDB/19.5°CWB  
 Outdoor temp. : 35°CDB
2. TOCA means the total value of each OC set
3. Voltage range  
 Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed operation range limits
4. Maximum allowable voltage unbalance between phases is 2%.
5. MCA/MFA  
 $MCA = 1.25 \times RLA + \text{all FLA}$ ,  $MFA = < 2.25 \times RLA + \text{all FLA}$   
 (next lower standard fuse rating Min. 16A)
6. Select wire size based on the larger value of MCA or TOCA
7. Instead of fuse, use circuit breaker
8. For more details concerning conditional connections, see <http://www.daikineurope.com/extranet>, select "Daikin Documentation" and select "conditional connection", "the requested product type" and "English" from the drop down lists, click the search button.  
 Finally, click on the document title of your choice.

1  
2

**REQ100B7**

Unit combination		Power supply					Compressor		OFM		IFM	
Indoor unit	Outdoor unit	Hz-Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FCQ100	REQ100B7V3B	50-230	Max. 50Hz-253V Min. 50Hz-207V	23.8	34.8	40	98.5	17.6	0.090	0.8	0.090	1.0
FHQ100	REQ100B7V3B	50-230		25.3	34.5	40	98.5	19.0	0.090	0.8	0.130	0.7
FBQ100	REQ100B7V3B	50-230		23.2	34.8	40	98.5	17.1	0.090	0.8	0.135	1.0
FDEQ100	REQ100B7V3B	50-230		24.2	34.8	40	98.5	17.9	0.090	0.8	0.135	1.0
FCQ100	REQ100B7W1B	50-400/230	Max. 50Hz-440/253V Min. 50Hz-360/207V	9.2	11.8	16	48.2	5.9	0.090	0.8	0.090	1.0
FHQ100	REQ100B7W1B	50-400/230		9.4	11.5	16	48.2	6.3	0.090	0.8	0.130	0.7
FBQ100	REQ100B7W1B	50-400/230		8.9	11.8	16	48.2	5.7	0.090	0.8	0.135	1.0
FDEQ100	REQ100B7W1B	50-400/230		9.6	11.8	16	48.2	6.2	0.090	0.8	0.135	1.0

3TW26619-9

**SYMBOLS**

- MCA : Min. Circuit Amps
- TOCA : Total Over Current Amps
- MFA : Max. Fuse Amps (see note 7)
- LRA : Locked Rotor Amps
- RLA : Rated Load Amps
- OFM : Outdoor Fan Motor
- IFM : Indoor Fan Motor
- FLA : Full Load Amps
- kW : Rated motor output

**NOTES**

1. RLA is based on the following conditions:  
Indoor temp.: 27°CDB/19.5°CWB  
Outdoor temp. : 35°CDB
2. TOCA means the total value of each OC set
3. Voltage range  
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed operation range limits
4. Maximum allowable voltage unbalance between phases is 2%.
5. MCA/MFA  
 $MCA = 1.25 \times RLA + \text{all FLA}$ ,  $MFA = < 2.25 \times RLA + \text{all FLA}$   
(next lower standard fuse rating Min. 16A)
6. Select wire size based on the larger value of MCA or TOCA
7. Instead of fuse, use circuit breaker
8. For more details concerning conditional connections, see <http://www.daikineurope.com/extranet>, select "Daikin Documentation" and select "conditional connection", "the requested product type" and "English" from the drop down lists, click the search button.  
Finally, click on the document title of your choice.

**REQ125B7**

Unit combination		Power supply					Compressor		OFM		IFM	
Indoor unit	Outdoor unit	Hz-Volts	Voltage range	MCA	TOCA	MFA	LRA	RLA	kW	FLA	kW	FLA
FCQ125	REQ125B7W1B	50-400/230	Max. 50Hz-440/253V Min. 50Hz-360/207V	12.4	15.3	20	63	8.1	0.065 + 0.085	0.6 + 0.7	0.09	1.0
FHQ125	REQ125B7W1B	50-400/230		12.3	15.0	20	63	8.2	0.065 + 0.085	0.6 + 0.7	0.13	0.7
FBQ125	REQ125B7W1B	50-400/230		12.2	15.7	20	63	7.6	0.065 + 0.085	0.6 + 0.7	0.225	1.4
FDEQ125	REQ125B7W1B	50-400/230		12.6	15.7	20	63	7.9	0.065 + 0.085	0.6 + 0.7	0.225	1.4

3TW26639-9

**SYMBOLS**

- MCA : Min. Circuit Amps
- TOCA : Total Over Current Amps
- MFA : Max. Fuse Amps (see note 7)
- LRA : Locked Rotor Amps
- RLA : Rated Load Amps
- OFM : Outdoor Fan Motor
- IFM : Indoor Fan Motor
- FLA : Full Load Amps
- kW : Rated motor output

**NOTES**

1. RLA is based on the following conditions:  
Indoor temp.: 27°CDB/19.5°CWB  
Outdoor temp. : 35°CDB
2. TOCA means the total value of each OC set
3. Voltage range  
Units are suitable for use on electrical systems where voltage supplied to unit terminals is not below or above listed operation range limits
4. Maximum allowable voltage unbalance between phases is 2%.
5. MCA/MFA  
 $MCA = 1.25 \times RLA + \text{all FLA}$ ,  $MFA = < 2.25 \times RLA + \text{all FLA}$   
(next lower standard fuse rating Min. 16A)
6. Select wire size based on the larger value of MCA or TOCA
7. Instead of fuse, use circuit breaker
8. For more details concerning conditional connections, see <http://www.daikineurope.com/extranet>, select "Daikin Documentation" and select "conditional connection", "the requested product type" and "English" from the drop down lists, click the search button.  
Finally, click on the document title of your choice.

1  
2



## 2 - 4 Safety device settings

### REQ71~125B7

Safety device	Model	REQ71B7V3B	REQ100B7V3B	REQ125B7W1B
		REQ71B7W1B	REQ100B7W1B	
Fan motor thermal protector		Off 135 ±5°C		
		On 95 ±15°C		
HPS		Off 4,15 <sup>+0</sup> / <sub>-0,10</sub> Mpa		
		On 3,2 <sup>+0,15</sup> / <sub>-0,15</sub> Mpa		
LPS		Off -0,03 <sup>+0,02</sup> / <sub>-0,02</sub> Mpa		
		On 0,05 <sup>+0,03</sup> / <sub>-0,03</sub> Mpa		
Max discharge temperature		By thermistor and software control		
Overcurrent relay		By overcurrent sensor and software control		

4TW26321-2B

### 3 Options

1

3

#### REQ71~125B7

Name of option	Kit name		
	REQ71B7	REQ100B7	REQ125B7
Central drain plug	KKPJ5F180		

4TW26599-1

# 4 Dimensional drawing & centre of gravity

## 4 - 1 Dimensional drawing

**REQ71B7** unit (mm)

Hole for anchor bolt 4-M12

1 Gas pipe connection  $\phi$  15.9 flare  
 2 Liquid pipe connection -  $\phi$  9.5 flare  
 3 Service port (in the unit)  
 4 Grounding terminal M5 (in switch box)  
 5 Refrigerant piping intake  
 6 Power supply wiring intake (knock hole  $\phi$  34)  
 7 Control wiring intake (knock hole  $\phi$  27)  
 8 Drain outlet

3TW26324-1

1

4

**REQ100B7** unit (mm)

Hole for anchor bolt 4-M12


1 Gas pipe connection  $\phi$  15.9 flare  
 2 Liquid pipe connection -  $\phi$  9.5 flare  
 3 Service port (in the unit)  
 4 Grounding terminal M5 (in switch box)  
 5 Refrigerant piping intake  
 6 Power supply wiring intake (knock hole  $\phi$  34)  
 7 Control wiring intake (knock hole  $\phi$  27)  
 8 Drain outlet

3TW26344-1

REQ125B7

unit (mm)

Hole for anchor bolt  
4-M12

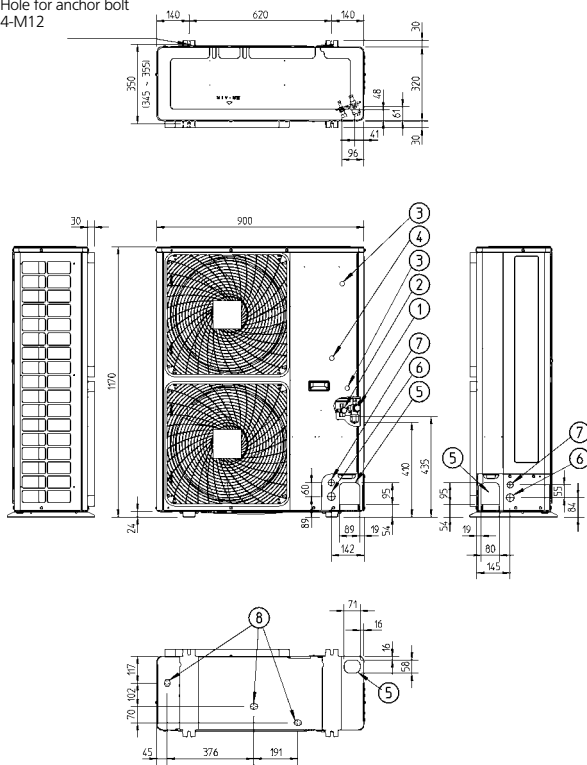


- 1 Gas pipe connection  $\phi$  15.9 flare
- 2 Liquid pipe connection -  $\phi$  9.5 flare
- 3 Service port (in the unit)
- 4 Grounding terminal M5 (in switch box)
- 5 Refrigerant piping intake
- 6 Power supply wiring intake (knock hole  $\phi$  34)
- 7 Control wiring intake (knock hole  $\phi$  27)
- 8 Drain outlet

3TW26364-1

4 - 2 Centre of gravity



REQ71B7

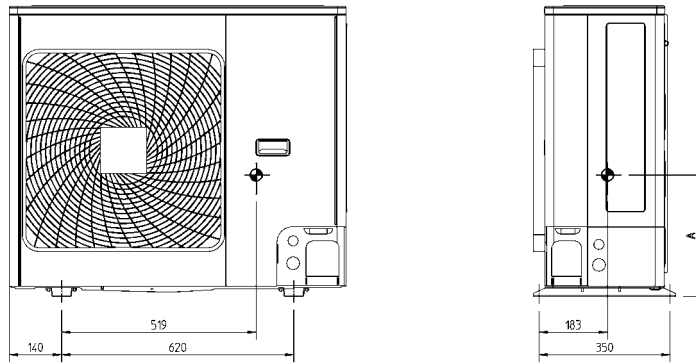

Model	A
REQ71B7	267

3TW26329-5C

REQ100B7

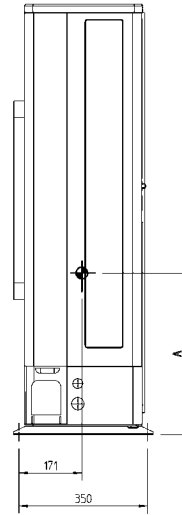
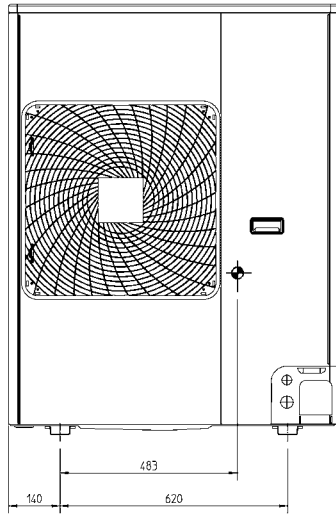


Model	A
REQ100B7	390

3TW26349-5C

1  
4

REQ125B7

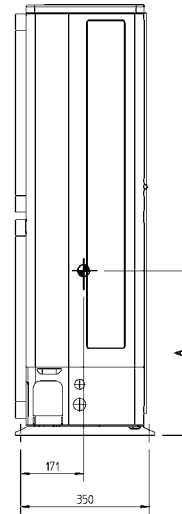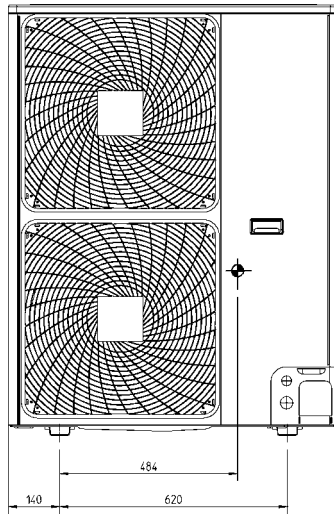


Model	A
REQ125B7	390

3TW26369-5C


# 5 Piping diagram

1  
5

REQ71~125B7 (Pair)

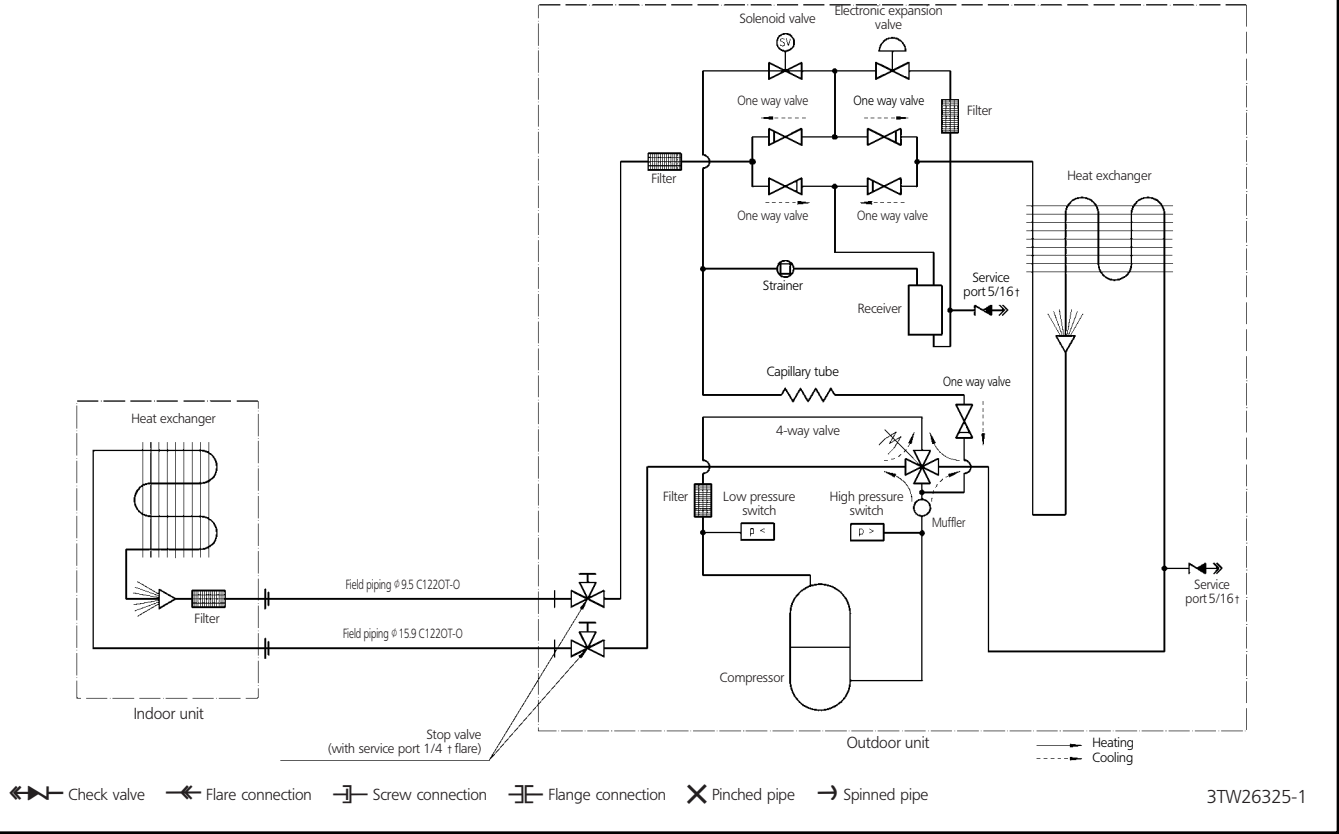



REQ71~125B7 (Twin)

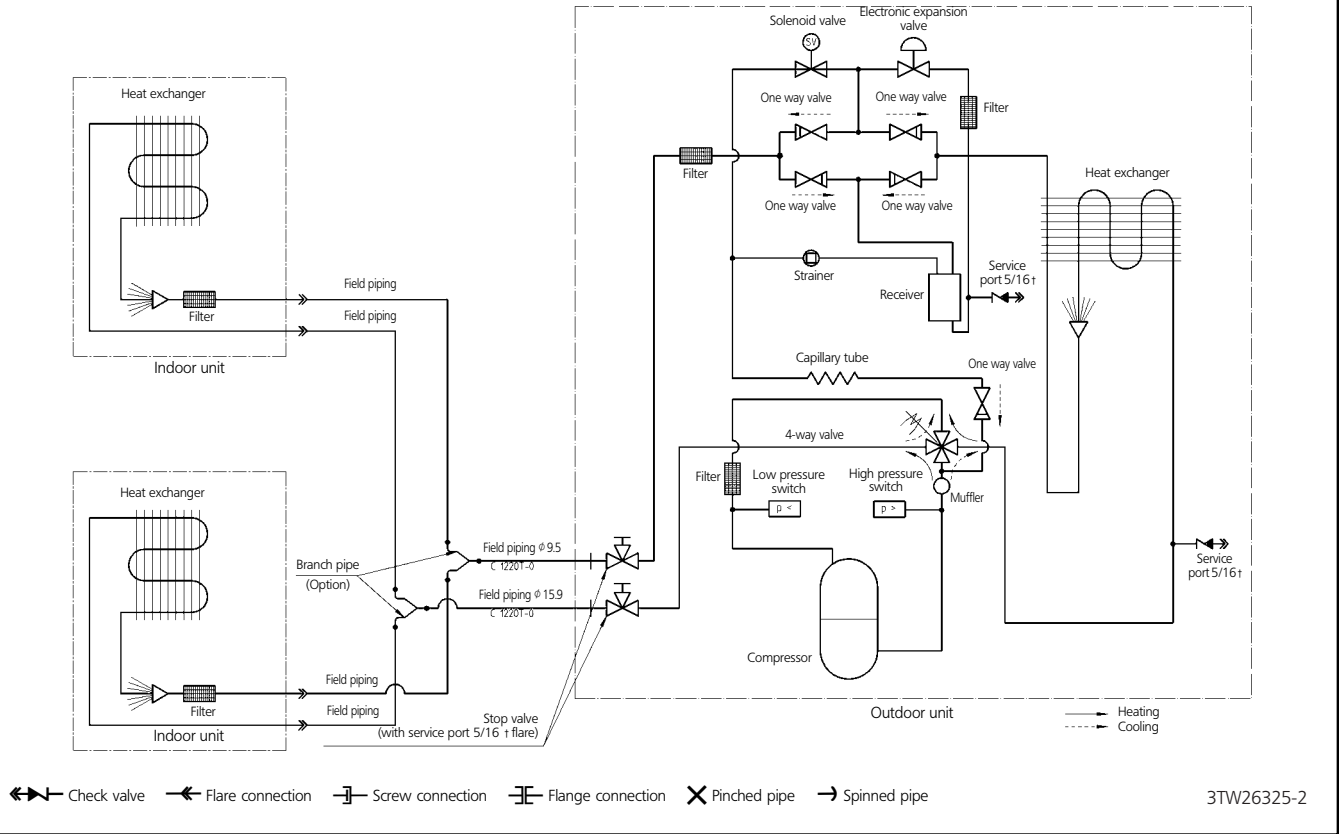

# 6 Wiring diagram


## 6 - 1 Wiring diagram

1  
6

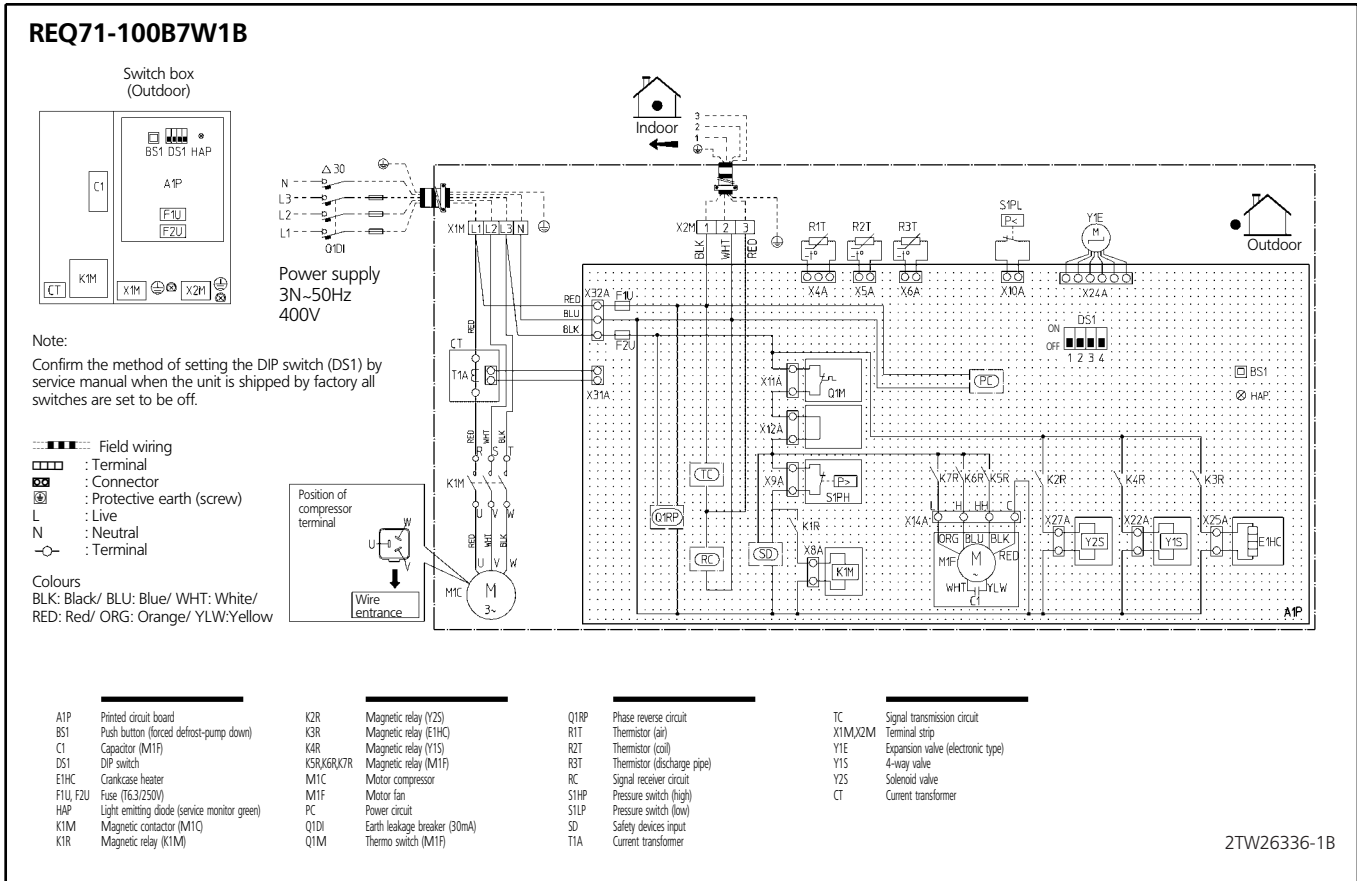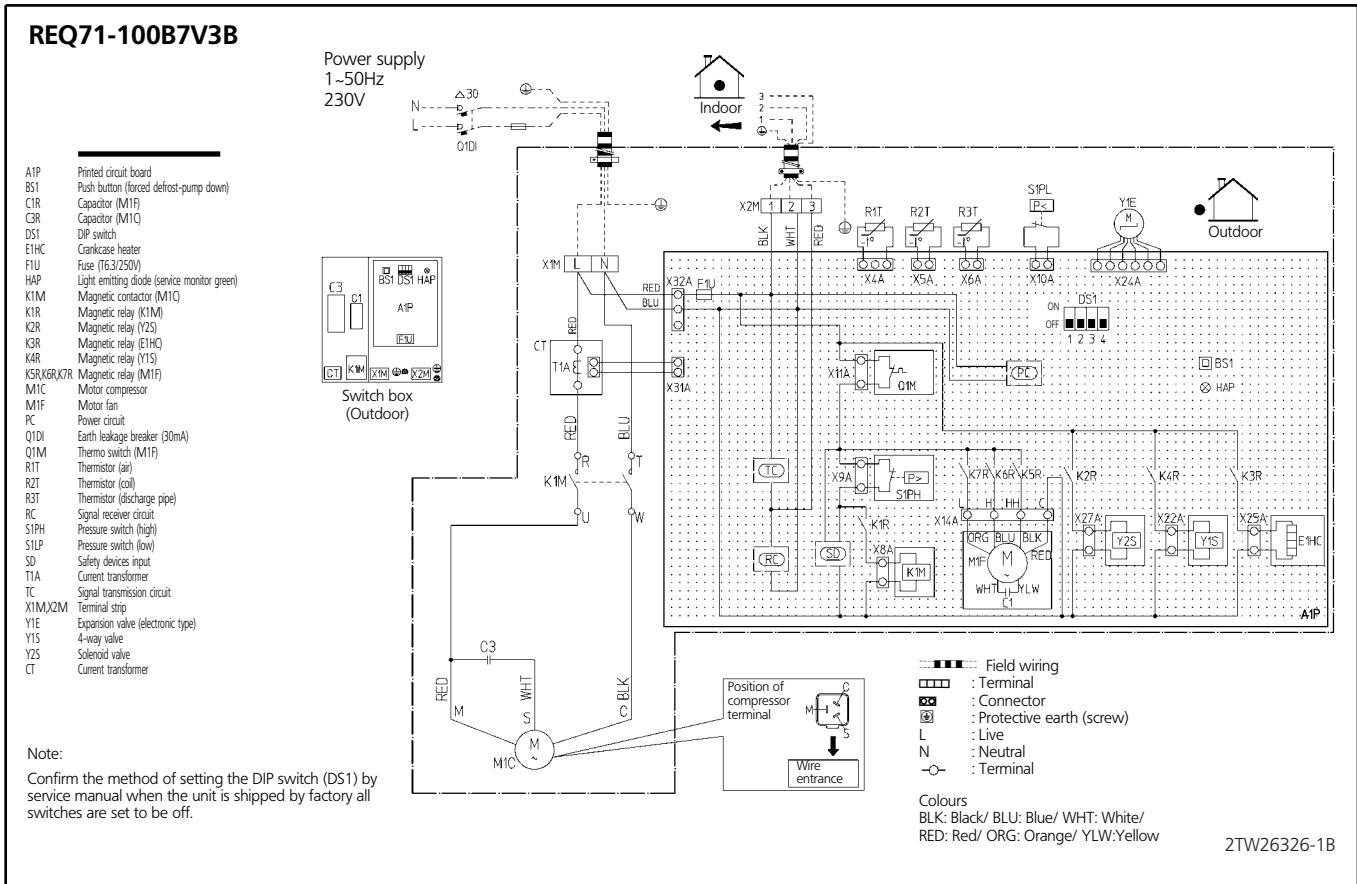

REQ125B7W1B

1  
6

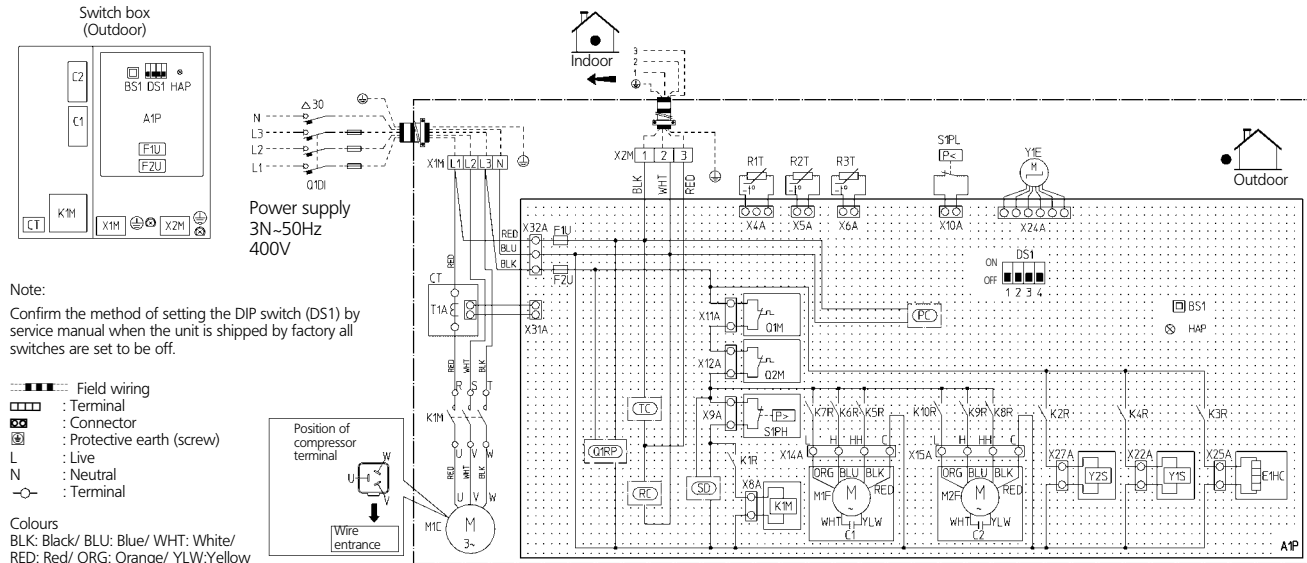


A1P	Printed circuit board	K1R	Magnetic relay (K1M)	Q1D	Earth leakage breaker (30mA)	S1P	Pressure switch (low)
BS1	Push button (forced defrost-pump down)	K2R	Magnetic relay (Y2S)	Q1M	Thermo switch (M1F)	SD	Safety devices input
C1	Capacitor (M1F)	K3R	Magnetic relay (E1HC)	Q2M	Thermo switch (M2F)	T1A	Current transformer
C2	Capacitor (M2F)	K4R	Magnetic relay (Y1S)	Q1RP	Phase reverse circuit	TC	Signal transmission circuit
DS1	DIP switch	K5R, K6R, K7R	Magnetic relay (M1F)	R1T	Thermistor (air)	X1M, X2M	Terminal strip
E1HC	Crankcase heater	K8R, K9R, K10R	Magnetic relay (M2F)	R2T	Thermistor (coil)	Y1E	Expansion valve (electronic type)
F1U, F2U	Fuse (T6.3/250V)	M1C	Motor compressor	R3T	Thermistor (discharge pipe)	Y1S	4-way valve
HAP	Light emitting diode (service monitor green)	M1F, M2F	Motor fan	RC	Signal receiver circuit	Y2S	Solenoid valve
K1M	Magnetic contactor (M1C)	PC	Power circuit	S1PH	Pressure switch (high)	CT	Current transformer

2TW26366-1B

6 - 2 External connection diagram

REQ71-125B7

Field wire

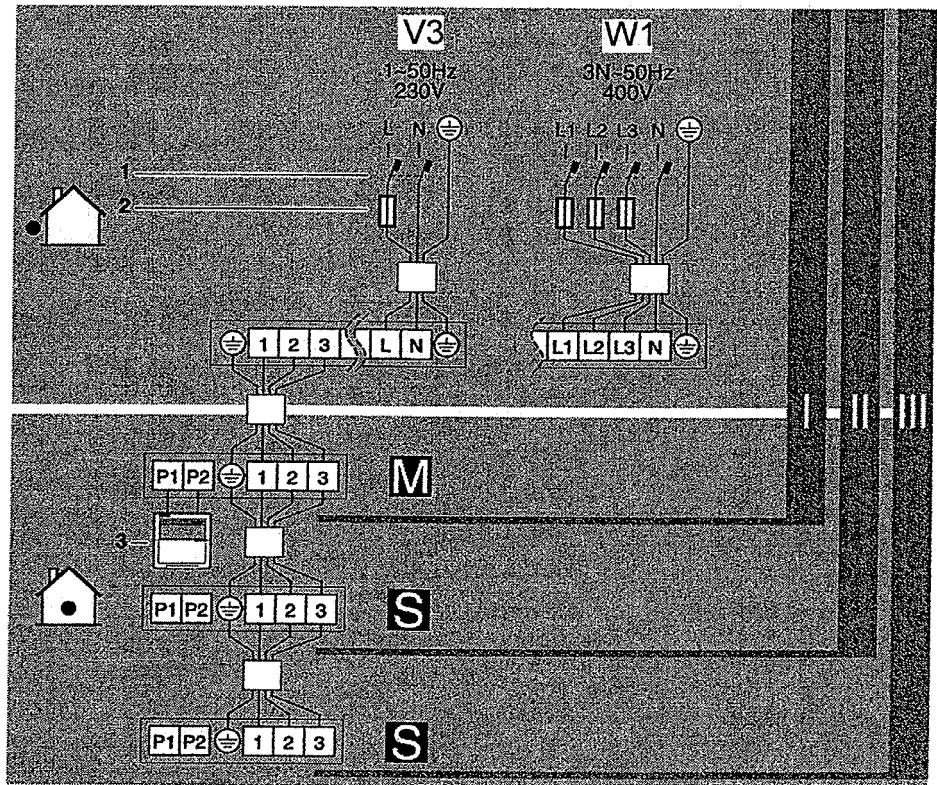

Symbol explication







- I = Pair
- II = Twin
- III = Triple
- M = Master
- S = Slave
- 1 = Earth leak detector
- 2 = Fuse
- 3 = Remote control

4TW26329-7



# 7 Sound data


## 7 - 1 Sound pressure spectrum

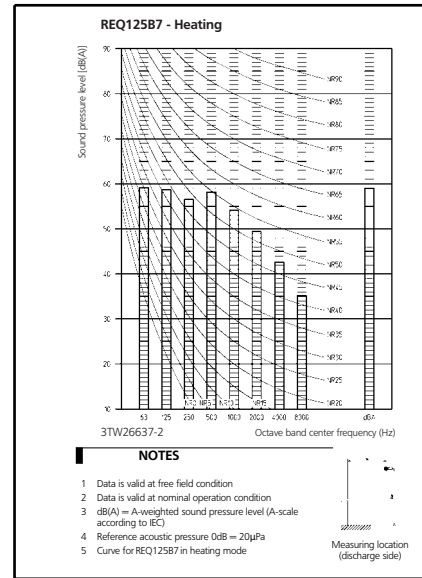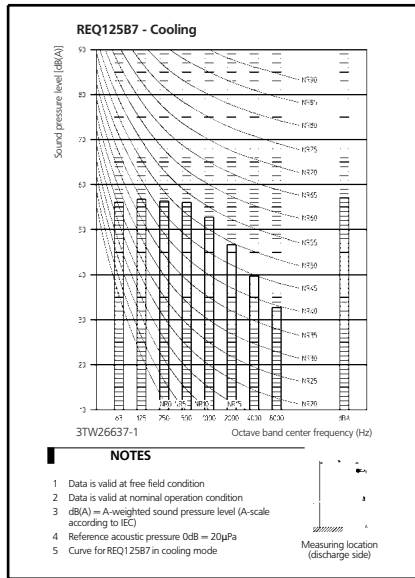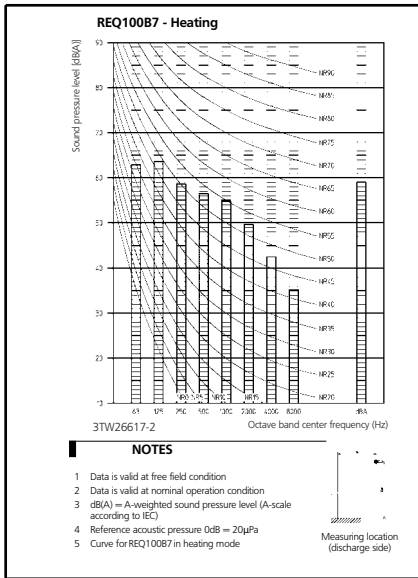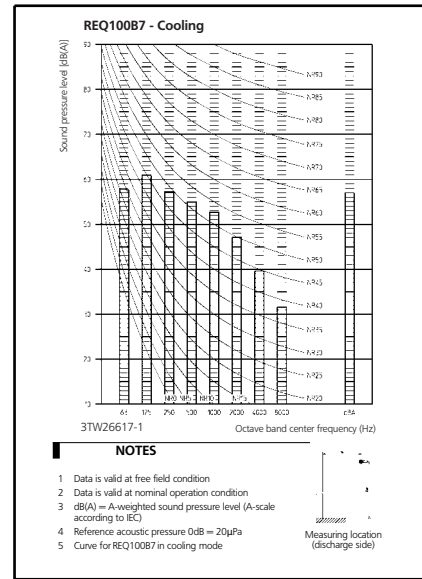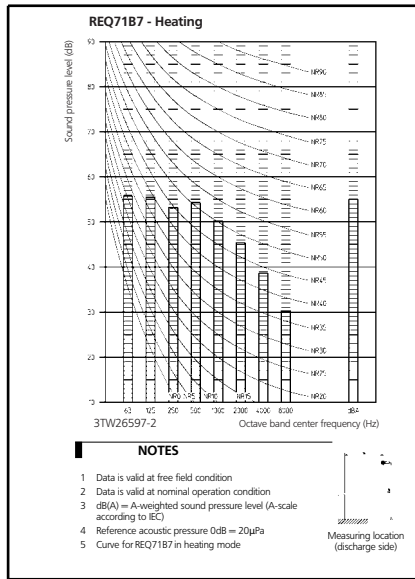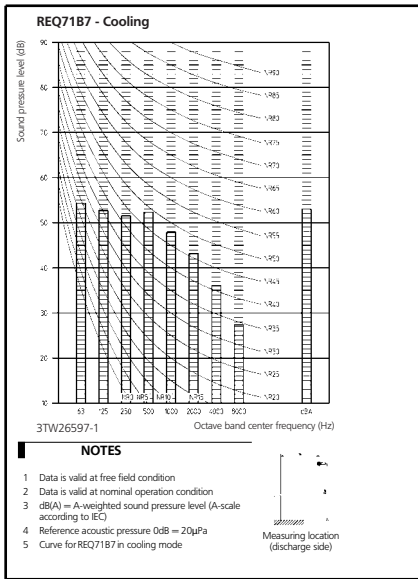

## 7 - 2 Sound power spectrum

1  
7


**REQ71B7 - Cooling**

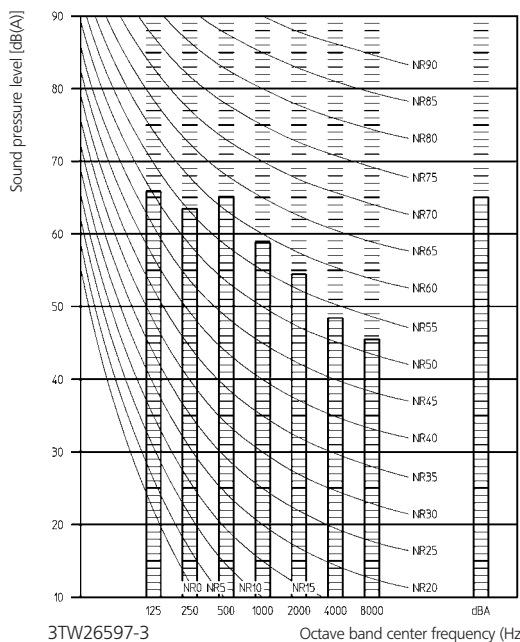

**NOTES**

- 1 Data is valid at free field condition
- 2 Data is valid at nominal operation condition
- 3 dB(A) = A-weighted sound pressure level (A-scale according to IEC)
- 4 Reference acoustic pressure 0dB = 20μPa
- 5 Curve for REQ71B7 in cooling mode


**REQ100B7 - Cooling**

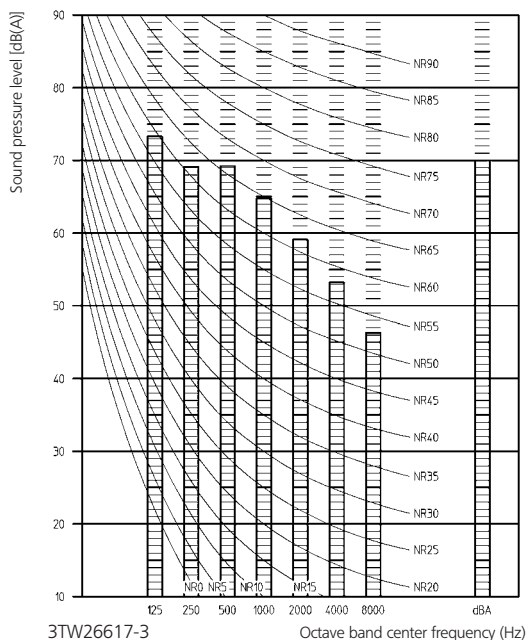

**NOTES**

- 1 Data is valid at free field condition
- 2 Data is valid at nominal operation condition
- 3 dB(A) = A-weighted sound pressure level (A-scale according to IEC)
- 4 Reference acoustic pressure 0dB = 20μPa
- 5 Curve for REQ100B7 in cooling mode

**REQ125B7 - Cooling**

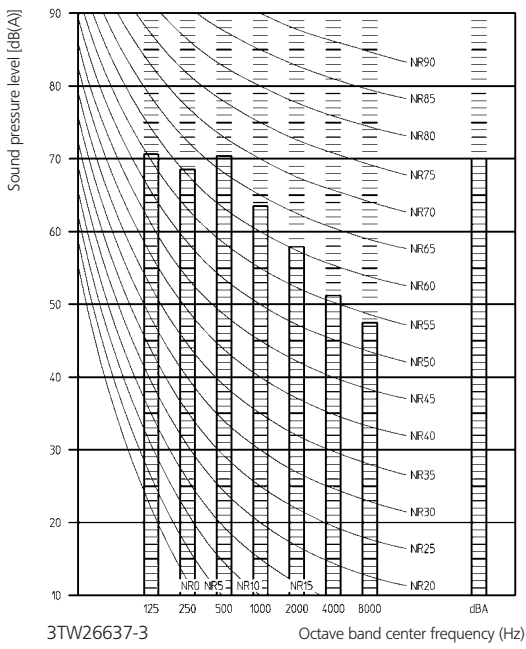

**NOTES**

- 1 Data is valid at free field condition
- 2 Data is valid at nominal operation condition
- 3 dB(A) = A-weighted sound pressure level (A-scale according to IEC)
- 4 Reference acoustic pressure 0dB = 20μPa
- 5 Curve for REQ125B7 in cooling mode


## 8 Installation

### 8 - 1 Installation method

REQ71~125B7

1  
8

#### Oil trap

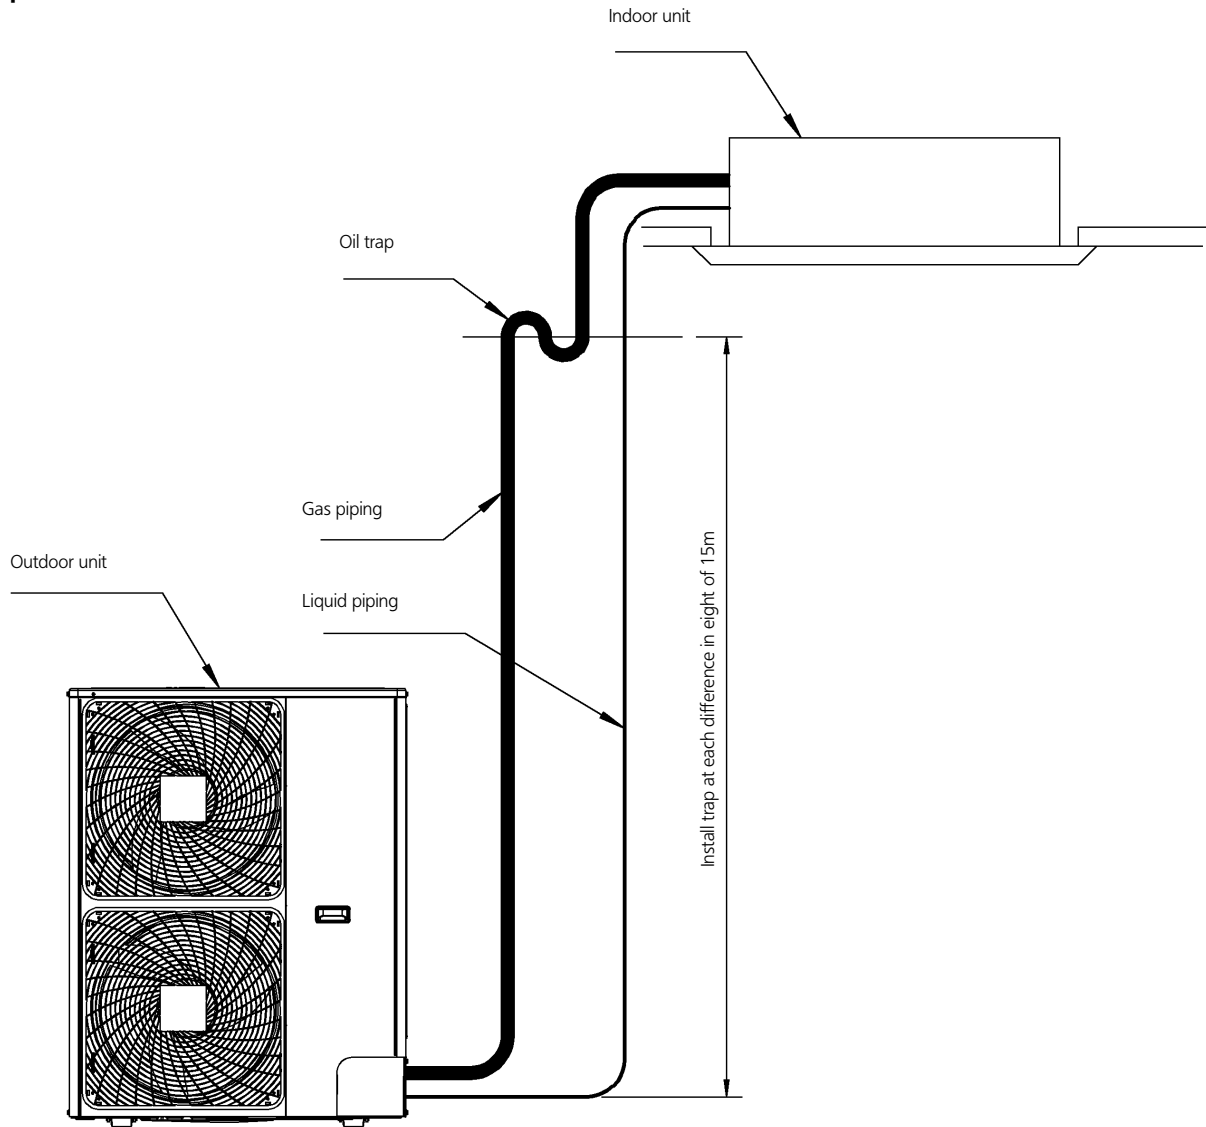

**NOTE:**

Since there is fear of the oil held inside the riser piping flowing back into the compressor when stopped and causing liquid compression phenomenon, or cases of deterioration of oil return, it will be necessary to provide a trap at an appropriate place in the riser gas piping.

A trap is not necessary when the outdoor unit is installed in a higher position than the indoor unit.

4TW25149-8

REQ71~125B7

A. Non stacked installation

		↖	↗	↘	↙	↕	A	B1	B2	C	D1	D2	E	L1/L2
	✓						≥50(100)							
	✓		✓	✓			≥100	≥100		≥100				
	✓				✓			≥100				≤500	≥1000	
	✓		✓	✓			≥150	≥150		≥150		≤500	≥1000	
	✓				✓						≥500			
	✓	✓									≥500		≥1000	
	✓						L1<L2	≥50(100)				≥500		
	✓						L2<L1	≥50(100)				≥500		
	✓						L1<L2	L1≤H	≥150(250)	≤500		≥750	≥1000	0<L1≤1/2H 0<L1≤1/2H
	✓	✓			✓		L2<L1	L2≤H	≥50(100) ≥100(200)		≥500 (1000)	≥500	≥1000	0<L2≤1/2H 1/2H<L2≤H
	✓		✓	✓			≥200	≥200(300)		≥1000				
	✓		✓	✓	✓		≥200	≥200(300)		≥1000				
	✓				✓				≤500		≥1000		≥1000	
	✓		✓	✓						≥1000				
	✓				✓		L1<L2	≥200(300)			≥1000			0<L2≤1/2H
	✓				✓		L2<L1	≥150(250) ≥200(300)			≥1000 (1500)			1/2H<L2≤H
	✓						L1<L2	L1≤H	≥200(300)	≤500		≥1000	≥1000	0<L1≤1/2H 1/2H<L1≤H
	✓						L2<L1	L2≤H	≥150(250) ≥200(300)		≥1000 (1500)	≤500	≥1000	0<L2≤1/2H 1/2H<L2≤H
	✓						L1<L2	L1≤H	≥200(300)	≤500		≥1000	≥1000	0<L1≤1/2H 1/2H<L1≤H
	✓						L2<L1	L2≤H	≥150(250) ≥200(300)		≥1000 (1500)	≤500	≥1000	0<L2≤1/2H 1/2H<L2≤H

Legend

- ↖ Suction side obstacle
- ↗ Discharge side obstacle
- ↘ Left side obstacle
- ↙ Right side obstacle
- ↕ Top side obstacle
- ✓ Obstacle is present


1 In these cases, close the bottom of the installation frame to prevent discharged air from being bypassed.

2 In these cases, only 2 units can be installed.

This situation is not allowed.


B. Stacked installation

1. Obstacles exist in front of the outlet side




Do not stack more than one unit.  
About 100mm is required as the dimension for laying the upper outdoor unit's drain pipe.  
Get the portion A sealed so that air from the outlet does not bypass.

2. Obstacles exist in front of the air inlet




C. Multiple-row installation

1. Installation of one unit per row



2. Installing multiple units (2 units or more) in lateral connection per row

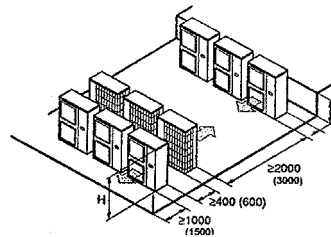

Relation of dimensions of H, A, and L are shown in the table below.


	L	A
L ≥ H	0 < L ≤ 1/2 H	150 (250)
	1/2 H < L	200 (300)
H < L	Installation impossible	

3TW25149-4A


# 9 Operation range

1  
9

## REQ71~125B7

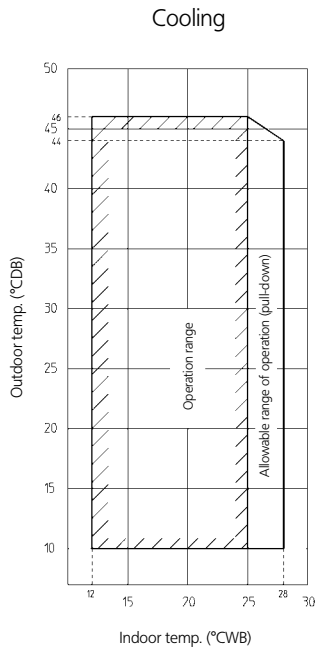

Model name		
REQ71B7V3B	REQ100B7V3B	REQ125B7W1B
REQ71B7W1B	REQ100B7W1B	

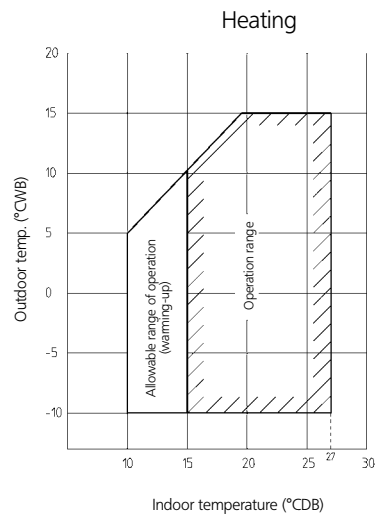

**Notes:**

- Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
- To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.

3TW26593-1